

**MODIFICATION TO CONCRETE STREET EDGE FOR APRON INSTALLATION**  
NOT TO SCALE

	MINIMUM *	TYPE
R1	20'	COMMERCIAL
R2	19.5'	COMMERCIAL
R3	20'	COMMERCIAL
R1	4'	RESIDENTIAL
R2	3.5'	RESIDENTIAL
R3	3'-10.5"	RESIDENTIAL
W	24'	COMMERCIAL
W	12'	RESIDENTIAL

\* IF SITE CONDITIONS PROHIBIT THE USE OF THESE STANDARDS, AN ALTERNATIVE MAY BE SUBMITTED FOR APPROVAL TO THE ENGINEERING DEPT.


\*\* EXPANSION JOINT MATERIAL TO MEET ALDOT SPECIFICATIONS 832.01 & 832.02

NOTE:  
CONCRETE APRON AND DRIVEWAY TO BE 5" MINIMUM THICKNESS.

SIDEWALK PANELS THAT ABUT THE DRIVEWAY TO BE 5" MINIMUM THICKNESS.

OTHER SIDEWALK PANELS TO BE 4" MINIMUM THICKNESS.

ALL CONCRETE TO BE 3000 P.S.I. MIX WITH NATURAL COLOR AND BROOM FINISH.

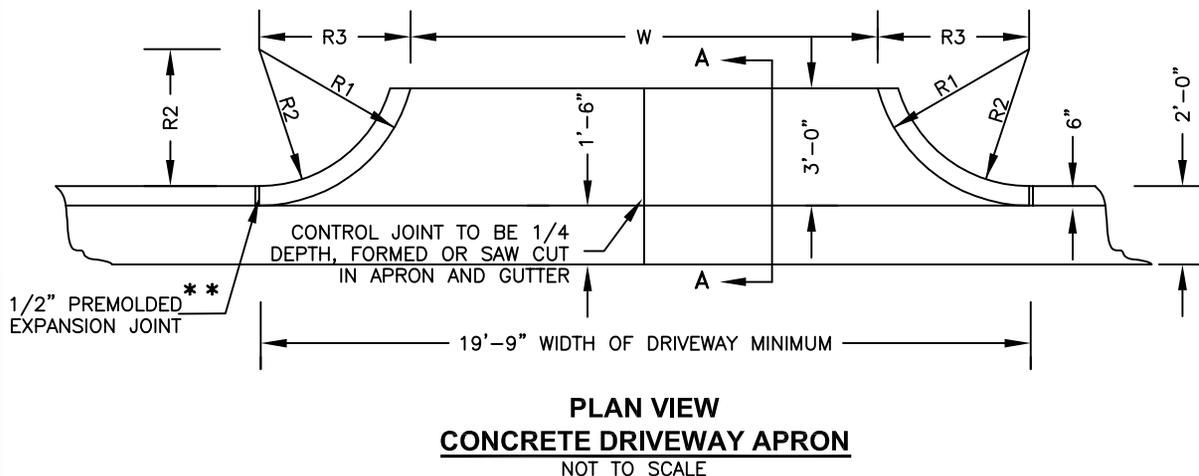

**CITY OF MOBILE, ALABAMA  
ENGINEERING DEPARTMENT**

**CONCRETE DRIVEWAY & SIDEWALK  
DETAILS FOR CONCRETE ROADWAY  
W/INTEGRAL OR SEPARATE CURB**