



SIDEWALK CROSS SECTION
 NOT TO SCALE


IF SITE CONDITIONS PROHIBIT THE USE OF THESE STANDARDS, AN ALTERNATIVE MAY BE SUBMITTED FOR APPROVAL TO THE ENGINEERING DEPT.

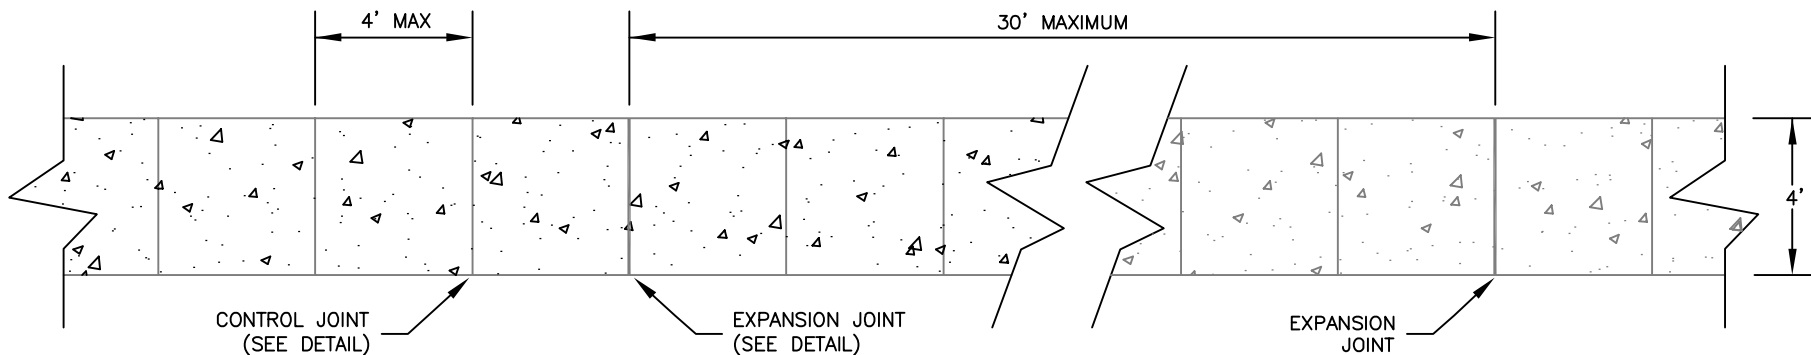

STANDARD SIDEWALK PLAN DETAIL
 NOT TO SCALE

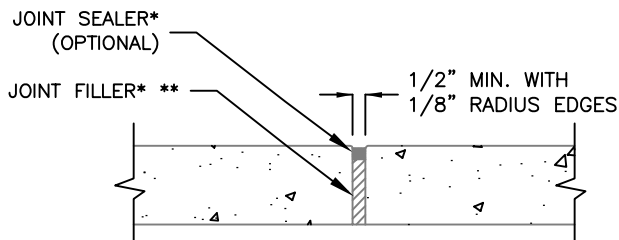

EXPANSION JOINT DETAIL
 NOT TO SCALE

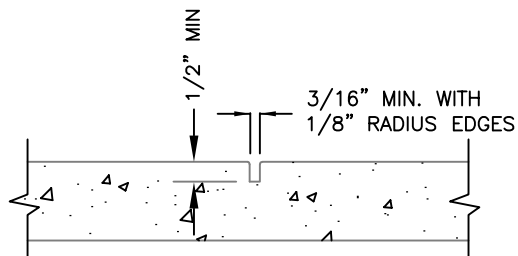


CONTROL JOINT DETAIL
 NOT TO SCALE

NOTES:

- SIDEWALK PANELS TO BE 4" MINIMUM THICKNESS.
- SIDEWALK PANELS THAT ABUT A DRIVEWAY OR WILL OTHERWISE BE SUBJECTED TO VEHICULAR TRAFFIC TO BE 5" MINIMUM THICKNESS.
- ALL CONCRETE TO BE 3000 P.S.I. MIX WITH NATURAL COLOR AND BROOM FINISH.
- EDGE OF SIDEWALK SHALL HAVE 1/2" RADIUS.

** JOINT FILLER TO BE CUT FLUSH WITH SIDEWALK SURFACE WHEN NO JOINT SEALER IS USED

*EXPANSION JOINT MATERIALS TO MEET ALDOT SPECIFICATIONS 832.01 & 832.02



**CITY OF MOBILE, ALABAMA
 ENGINEERING DEPARTMENT**

**CONCRETE SIDEWALK
 DETAILS**